



PERFORMANCE TEST REPORT

Rendered to:

CRIMSAFE NORTH AMERICA, LLC

**PRODUCTS: Fixed Screen, Safe-S-Cape Egress
and Hinged Security Screen Door**

Report No: 90809.02-106-31
Report Date: 06/05/09
Expiration Date: 06/03/13

PERFORMANCE TEST REPORT

Rendered to:

CRIMSAFE NORTH AMERICA, LLC
3020 Reynolds Road, Units 1-3
Lakeland, Florida 33803

Report No: 90809.02-106-31
Test Dates: 04/15/09
Through: 06/03/09
Report Date: 06/05/09
Expiration Date: 06/03/13

Products: Fixed Screen, Safe-S-Cape Egress and Hinged Security Screen Door

Project Summary: Architectural Testing, Inc. was contracted by Crimsafe North America, LLC to perform testing in order to evaluate the compliance of three metal protection screen assemblies with ANSI/SMA 6001-2002. Testing included an Impact Resistance Test, a Sag Test, a Forced Entry Test and Thickness measurements. The test specimens were supplied by Crimsafe North America, LLC and were visually inspected before testing. The protection screens tested met the performance requirements of ANSI/SMA 6001-2002 as follows:

Product	Class
Fixed Screen	Medium
Safe-S-Cape Egress	Heavy
Hinged Security Screen Door	Heavy

Test Method Description: The tensile strength of the screen material was tested in accordance with ASTM E 8. The test specimens were machined and sized as sheet type. The specimens were tested using a SATEC Unidrive, Model MII 50 UD Universal Testing Machine (ICN Y002011) with a cross-head speed of 0.2" per minute. For the remainder of the testing program, screen assemblies were mounted to a rigid test frame.

For the impact tests, an 11" diameter impact ball meeting the description in the test method and weighing 33 pounds was attached to a pendulum system and positioned to impact on the exterior side of the screen at its weakest location (mid-height and midspan of the unrestrained mesh area). The pendulum was pulled back to a vertical height of 1.5 feet above its resting position in order to produce a 50 foot-pound impact force at the bottom of the pendulum arc, and 3 feet above its resting position in order to produce a 100 foot-pound impact force. The ball was then released and the specimens were inspected for damage after impact.

Test Method Description: (Continued)

For the sag test, the screens were opened 90° and a load was applied vertically downward at a distance of 2 feet 6 inches from the hinge axis for a continuous period of five minutes. At the conclusion of this period, the load was removed and the permanent set recorded.

For the forced entry resistance test, the screens were prepared with loading mounts at quarter-point positions of the stile opposite of the hinge side of the screen panel. A load was then applied in the plane of the screens in a direction away from the screen frame tending to create a gap between the frame and the panel on the lock side. A second load was then applied to the same attachment point as the first load, only in a direction away from the plane of the screens tending to open it. These loads were held for ten seconds and released. This load sequence was repeated with the in-plane load reversed (tending to jam the panel into the frame).

Test Results: The results are reported in the following tables.

Screening Material

Test No.	Tensile Strength (lb/in.)
1	1,058
2	921
3	1,135
4	931
5	896
6	1,019
Average	993
Allowable	>800

**Fixed Screen
Class Level - Medium**

	Impact Test	Thickness
Test Value	50 ft·lb	0.066"
Result	<3"	
Allowable	≤3"	

Test Results: (Continued)

**Safe-S-Cape Egress
Class Level - Heavy**

	Impact Test	Sag Test	Forced Entry Test	Thickness
Test Value	100 ft·lb	90 lb	50 and 150 lb side loads 300 lb open load	0.066"
Result	< 3"	0.000"	Pass	
Allowable	≤ 3"	≤0.062"	Pass	

**Hinged Security Screen Door
Class Level - Heavy**

	Impact Test	Sag Test	Forced Entry Test	Thickness
Test Value	100 ft·lb	90 lb	50 and 150 lb side loads 300 lb open load	0.066"
Result	< 3"	0.000"	Pass	
Allowable	≤ 3"	≤0.062"	Pass	

Observations: Drawings for the three screen products can be found in Appendix A. The measurement system employed for the impact tests consisted of an impressionable surface mounted 3 inches behind the screen. After impact, this surface was inspected for markings to detect deflections of 3 inches or more. No tearing of the screen material was observed at the indicated impact levels, nor was there evidence of deflection of the screen beyond three inches.

A dial indicator was used to measure permanent set for the sag test (See Photograph No. 3 in Appendix B).

For the forced entry test, a 1/4-inch diameter rod was used as a feeler gage to verify that no separation between the operable frame and subframe was greater than 1/4-inch. All locking devices remained engaged and operable, and the operating frame remained secure.

Data sheets, representative samples of test specimens, a copy of this test report will be retained by Architectural Testing, Inc. for a period of four years from the original test date. At the end of this retention period such materials shall be discarded without notice and the service life of this report by Architectural Testing will expire. Results obtained are tested values and were secured using the designated test methods. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimens tested. This report may not be reproduced, except in full, without the written approval of Architectural Testing, Inc.

For ARCHITECTURAL TESTING, INC.:

Rodney E. Holland - Technician II
Components / Materials Testing

Gary Hartman, P.E. - Director
Components / Materials Testing

REH:reh/nlb

Attachments (pages) This report is complete only when all attachments listed are included.

Appendix A - Drawings (5)


Appendix B - Photographs (3)

Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
0	06/05/09	N/A	Original report issue.


APPENDIX A

Drawings

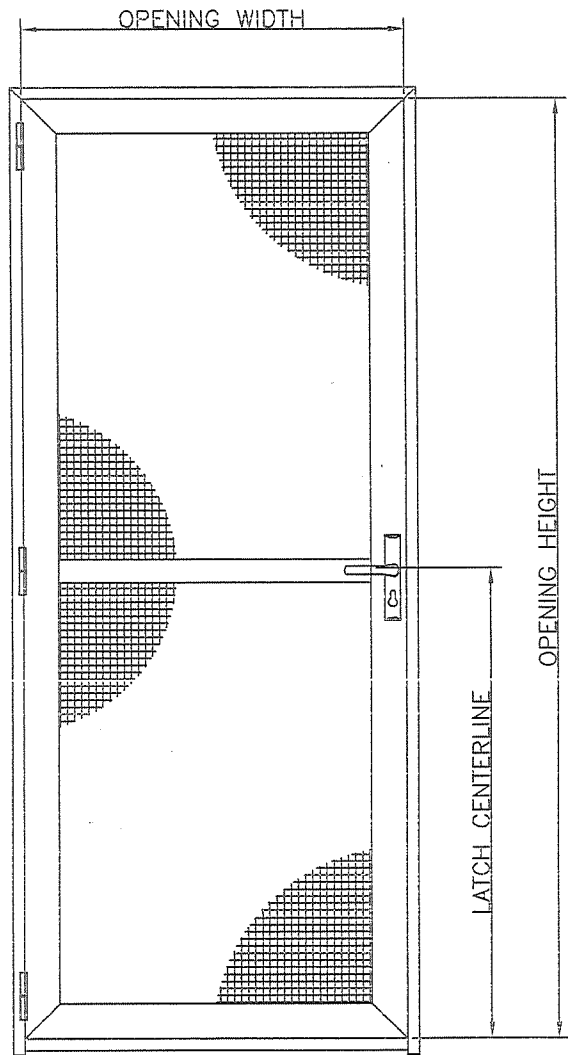

FACE SIDE

NOT TO SCALE

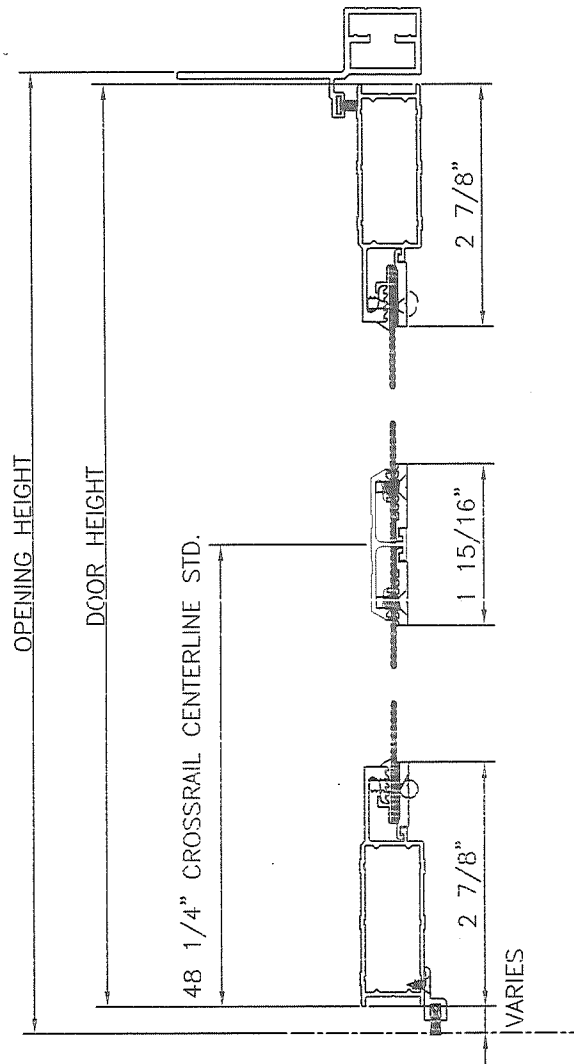

* ALL DIMENSIONS ARE IN INCHES



THE INFORMATION CONTAINED IN THIS DRAWING IS SOLE PROPERTY OF CRIMS SAFE SECURITY SYSTEMS PTY LTD. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OR AGREEMENT OF CRIMS SAFE PRODUCTS IS PROHIBITED. THIS IS A REGISTERED DESIGN UNDER CRIMS SAFE SECURITY SYSTEMS PTY LTD.

Crimsafe North America

Phone: +1 863 510 0188

Fax: +1 863 665 0485

Product:
HINGED SECURITY SCREEN DOOR

Rev.	Description

DRAWN BY: CC. 11 Mar 09

CHECKED BY: RR. 11 Mar 09

APPROVED BY: Peter Bouma 11 Mar 09

SCALE: N.T.S

INTERNAL DWG CODE: A2020-0003

Sheet 1 of 2



THE INFORMATION CONTAINED IN THIS DRAWING IS SOLE PROPERTY OF CRIMSAFE SECURITY SYSTEMS PTY LTD. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OR AGREEMENT OF CRIMSAFE PRODUCTS IS PROHIBITED. THIS IS A REGISTERED DESIGN UNDER CRIMSAFE SECURITY SYSTEMS PTY LTD.

Crimsafe North America

Phone: +1 863 510 0188

Fax: +1 863 665 0485

Product:
HINGED SECURITY SCREEN DOOR


Rev.	Rev. Description

DRAWN BY:	CC.	09 Mar 09
CHECKED BY:	RR.	09 Mar 09
APPROVED BY:	Peter Bouma	09 Mar 09

SCALE: N.T.S.

INTERNAL DWG CODE:
A2020-0003

Sheet
2 of 2

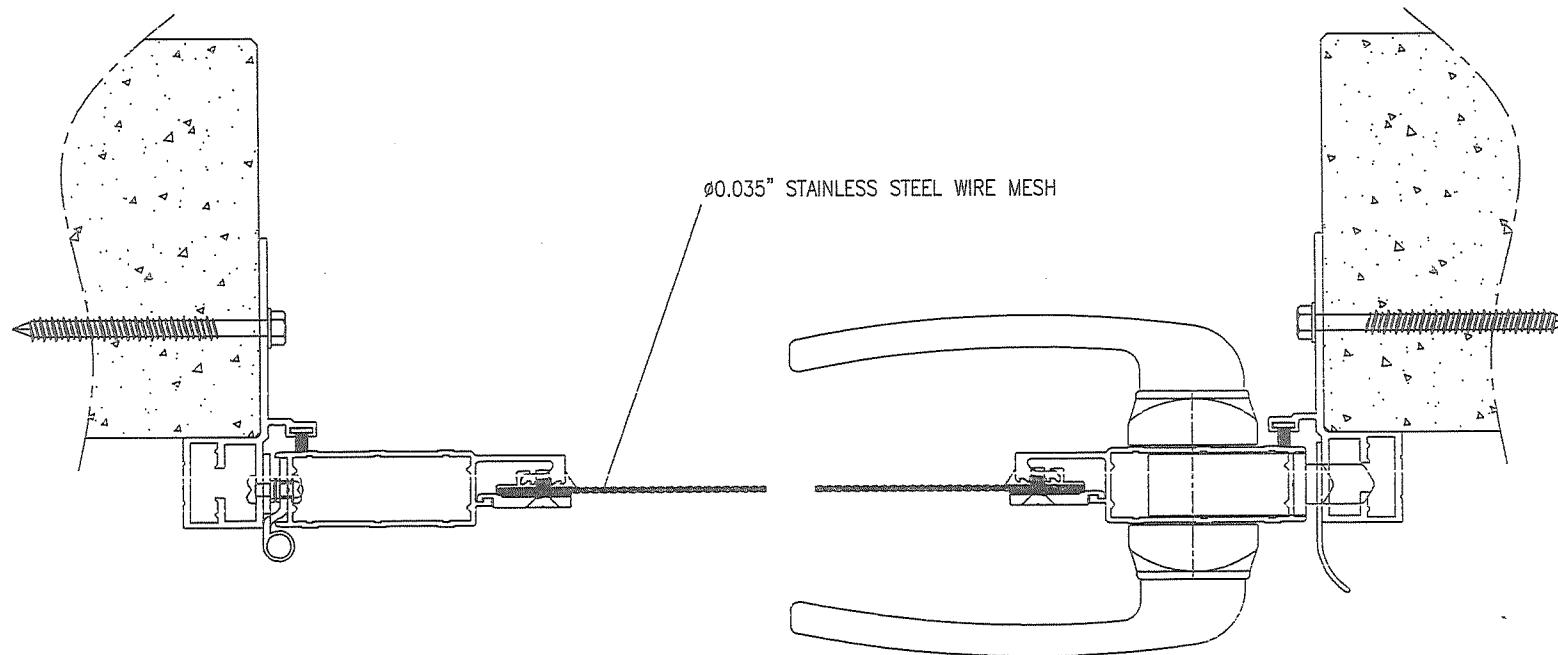

NOT TO SCALE

* ALL DIMENSIONS ARE IN INCHES



THE INFORMATION CONTAINED IN THIS DRAWING IS SOLE PROPERTY OF CRIMS SAFE SECURITY SYSTEMS PTY LTD. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OR AGREEMENT OF CRIMS SAFE PRODUCTS IS PROHIBITED. THIS IS A REGISTERED DESIGN UNDER CRIMS SAFE SECURITY SYSTEMS PTY LTD.

Crimsafe North America

Phone: +1 863 510 0188

Fax: +1 863 665 0485

Product:

**SAFE -S - CAPE
SECURITY SCREEN
WINDOW**


Rev.	Description

DRAWN BY:	CC.	17 Mar 09
CHECKED BY:	RR.	17 Mar 09
APPROVED BY:	Peter Bouma	17 Mar 09

SCALE: N.T.S


INTERNAL DWG CODE:
A2020-0004

Sheet
1 of 2

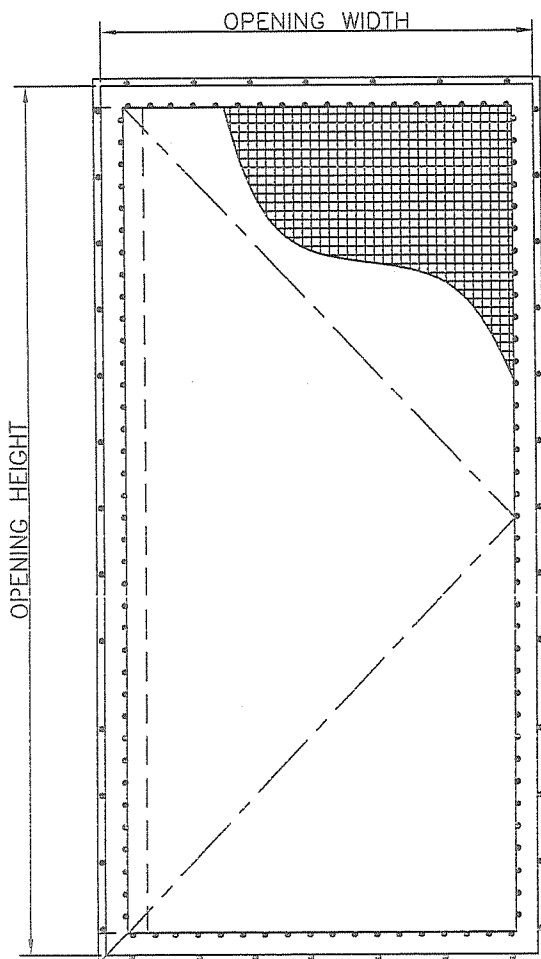

FACE SIDE

NOT TO SCALE

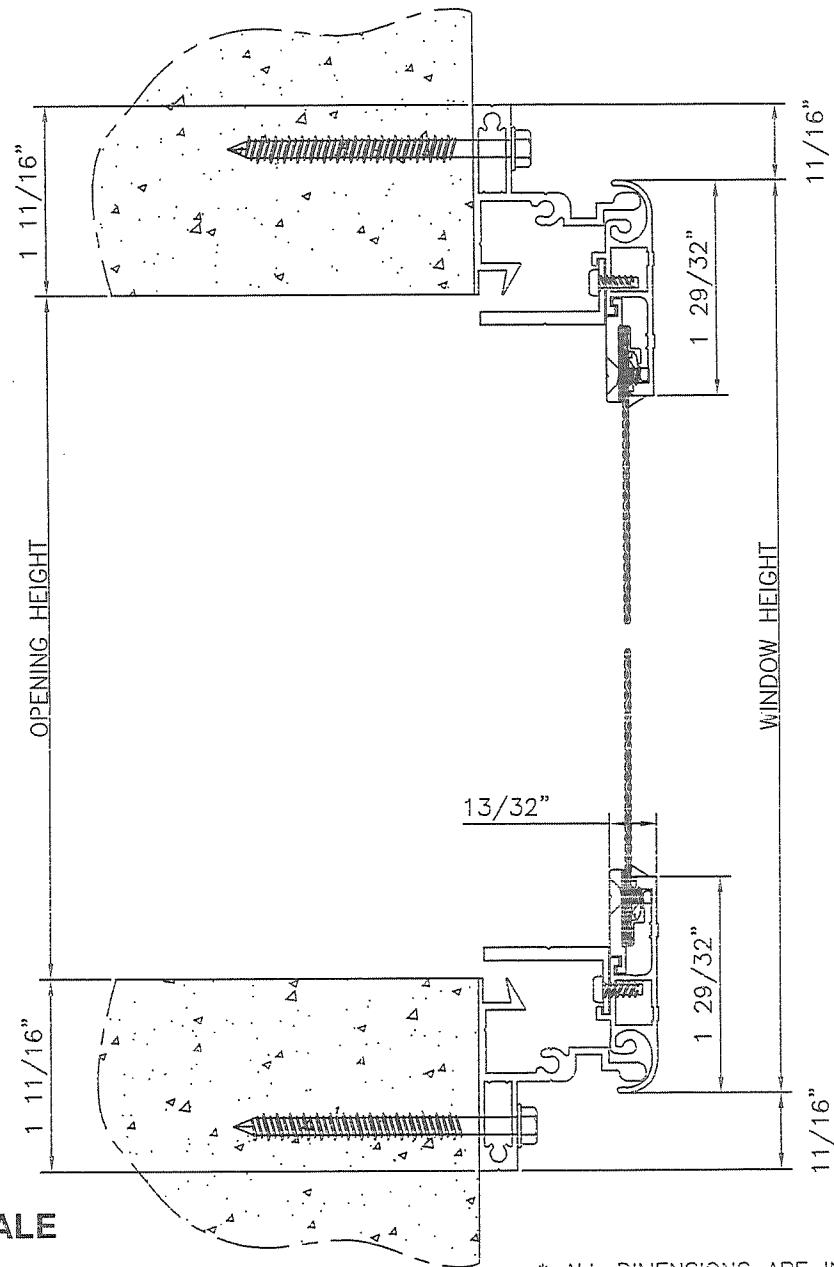

* ALL DIMENSIONS ARE IN INCHES



THE INFORMATION CONTAINED IN THIS DRAWING IS SOLE PROPERTY OF CRIMS SAFE SECURITY SYSTEMS PTY LTD. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OR AGREEMENT OF CRIMS SAFE PRODUCTS IS PROHIBITED. THIS IS A REGISTERED DESIGN UNDER CRIMS SAFE SECURITY SYSTEMS PTY LTD.

Crimsafe North America
 Phone: +1 863 510 0188
 Fax: +1 863 665 0485

Product:
**BUILT OUT TYPE
 FIXED SECURITY
 SCREEN WINDOW**


Rev.	Rev. Description

DRAWN BY:	CC.	27 Apr 09
CHECKED BY:	RR.	27 Apr 09
APPROVED BY:	Peter Bouma	27 Apr 09

SCALE: N.T.S


INTERNAL DWG CODE:
 A2020-0005

Sheet
 1 of 2

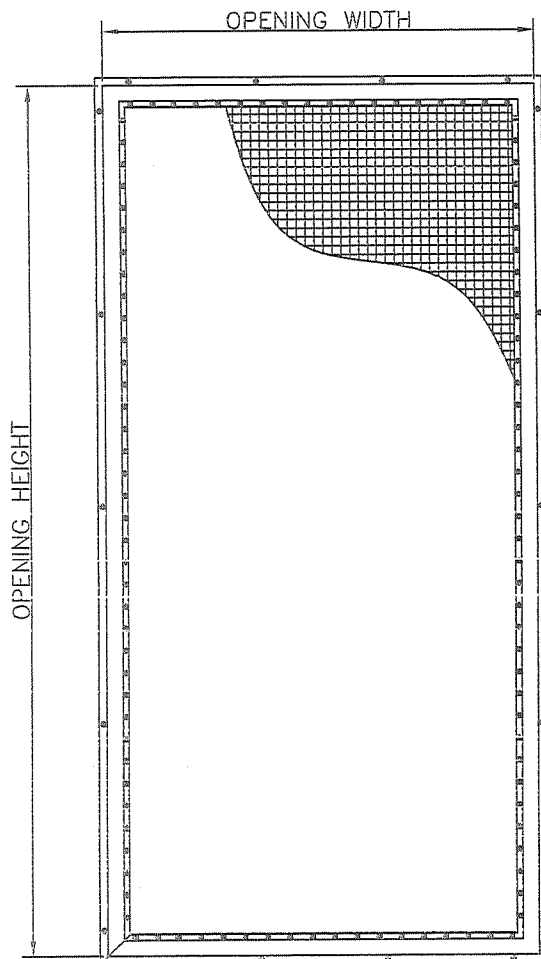

FACE SIDE

NOT TO SCALE

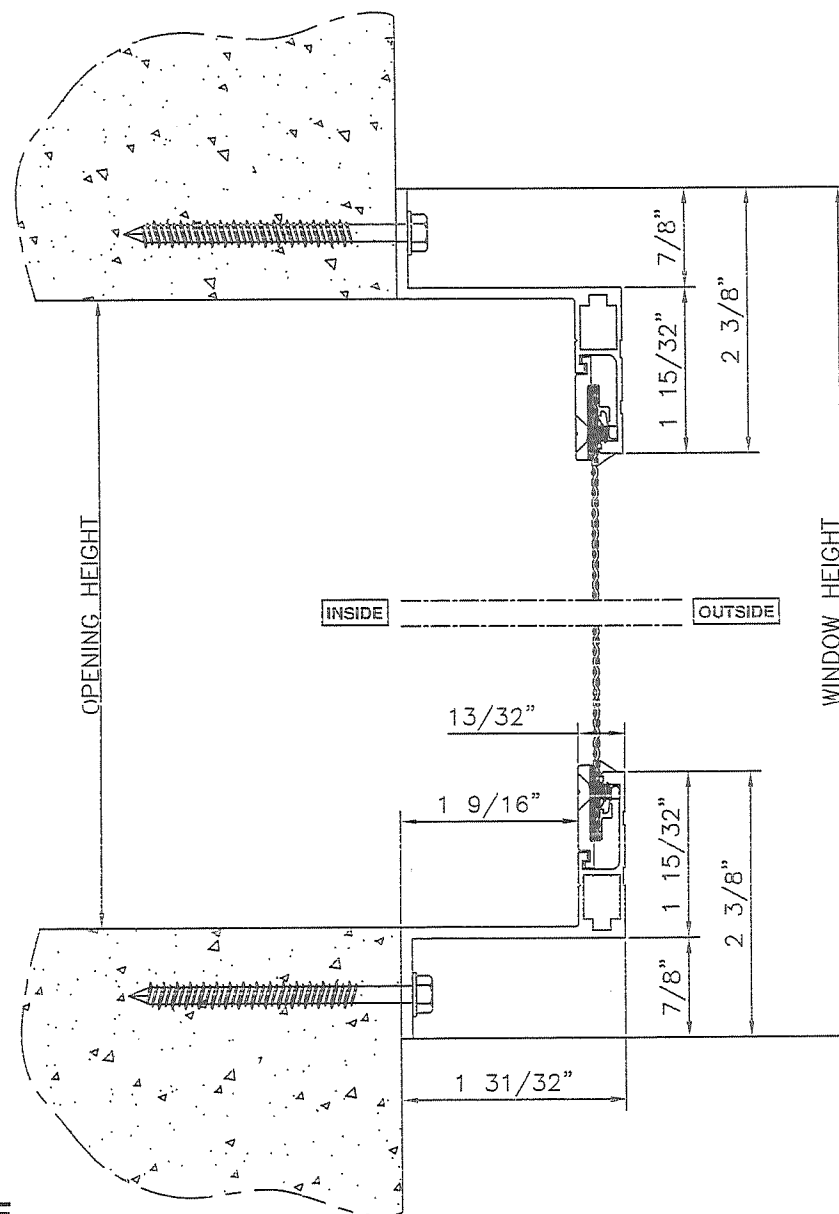

* ALL DIMENSIONS ARE IN INCHES



THE INFORMATION CONTAINED IN THIS DRAWING IS SOLE PROPERTY OF CRIMS SAFE SECURITY SYSTEMS PTY LTD. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OR AGREEMENT OF CRIMS SAFE PRODUCTS IS PROHIBITED. THIS IS A REGISTERED DESIGN UNDER CRIMS SAFE SECURITY SYSTEMS PTY LTD.

Crimsafe North America
 Phone: +1 863 510 0188
 Fax: +1 863 665 0485

Product:
**BUILT OUT TYPE
 FIXED SECURITY
 SCREEN WINDOW**


Rev.	Rev. Description

DRAWN BY:	CC.	27 Apr 09
CHECKED BY:	RR.	27 Apr 09
APPROVED BY:	Peter Bouma	27 Apr 09

SCALE: N.T.S

INTERNAL DWG CODE:
 A2020-0005

Sheet
 2 of 2

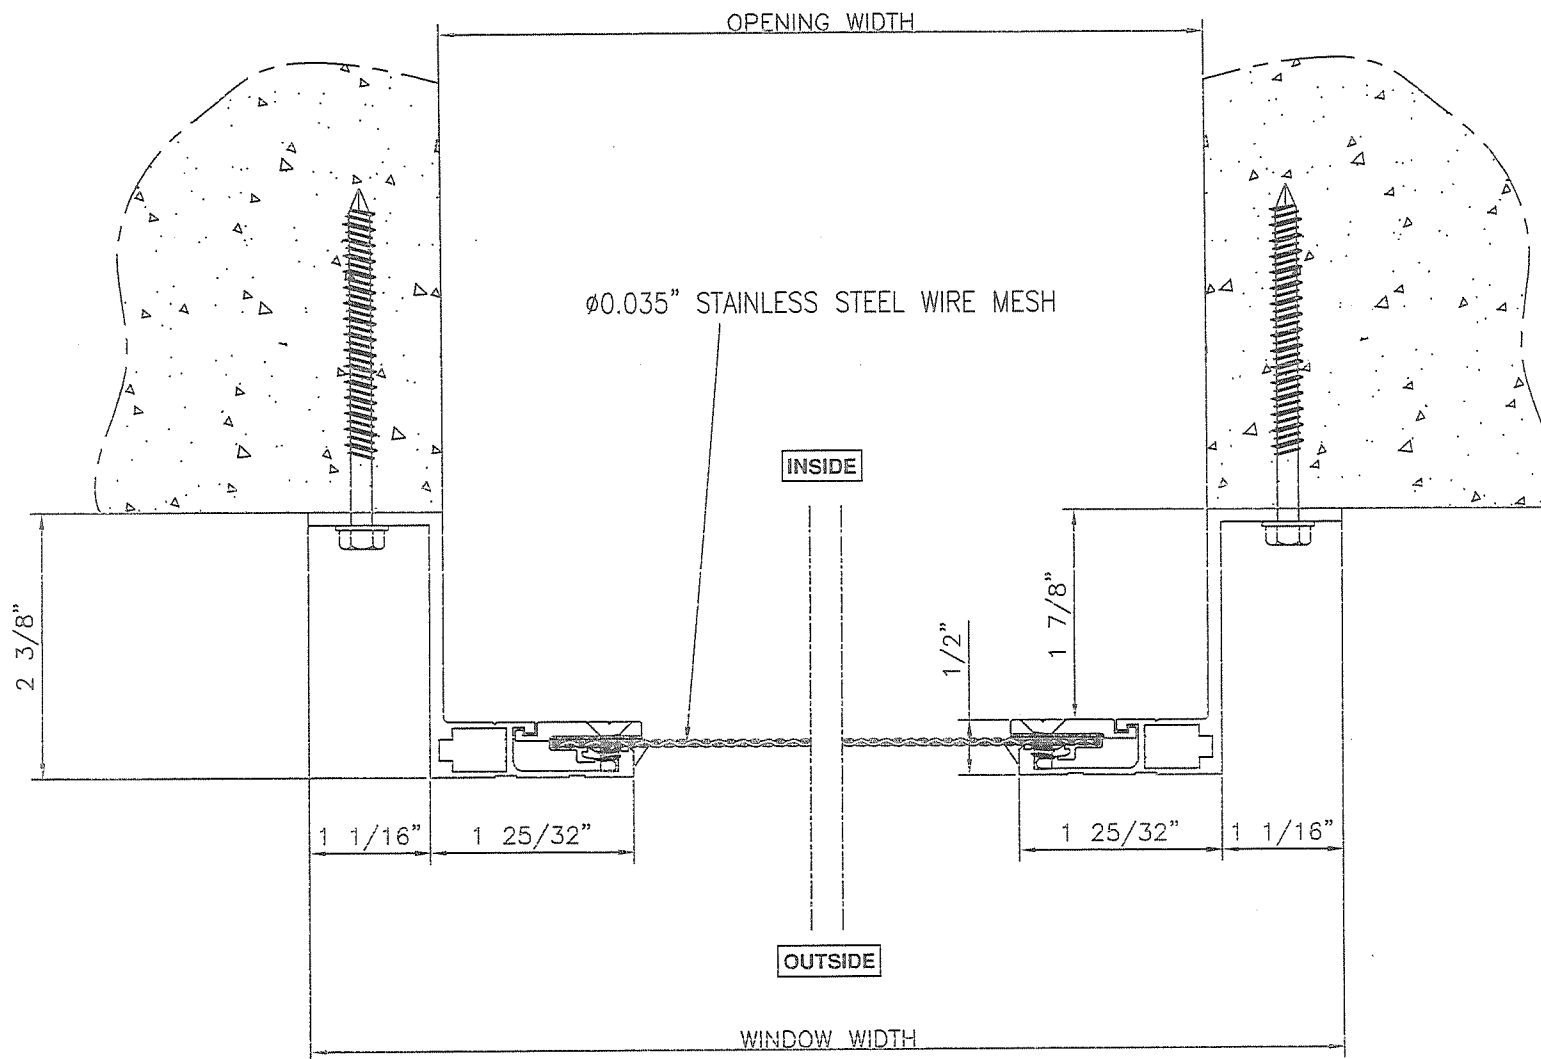

* ALL DIMENSIONS ARE IN INCHES

APPENDIX B

Photographs

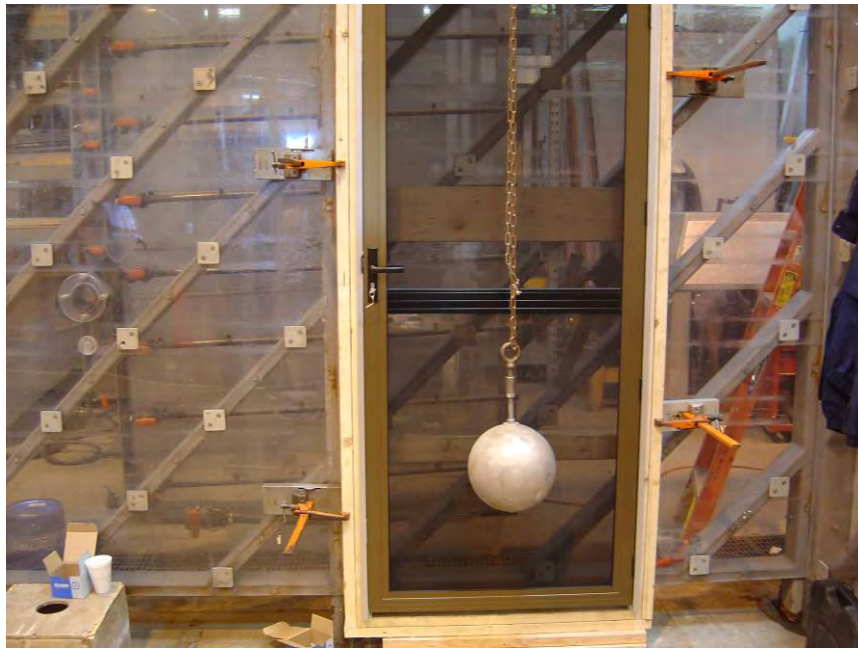


Photo No. 1
Test Setup of Impact Test

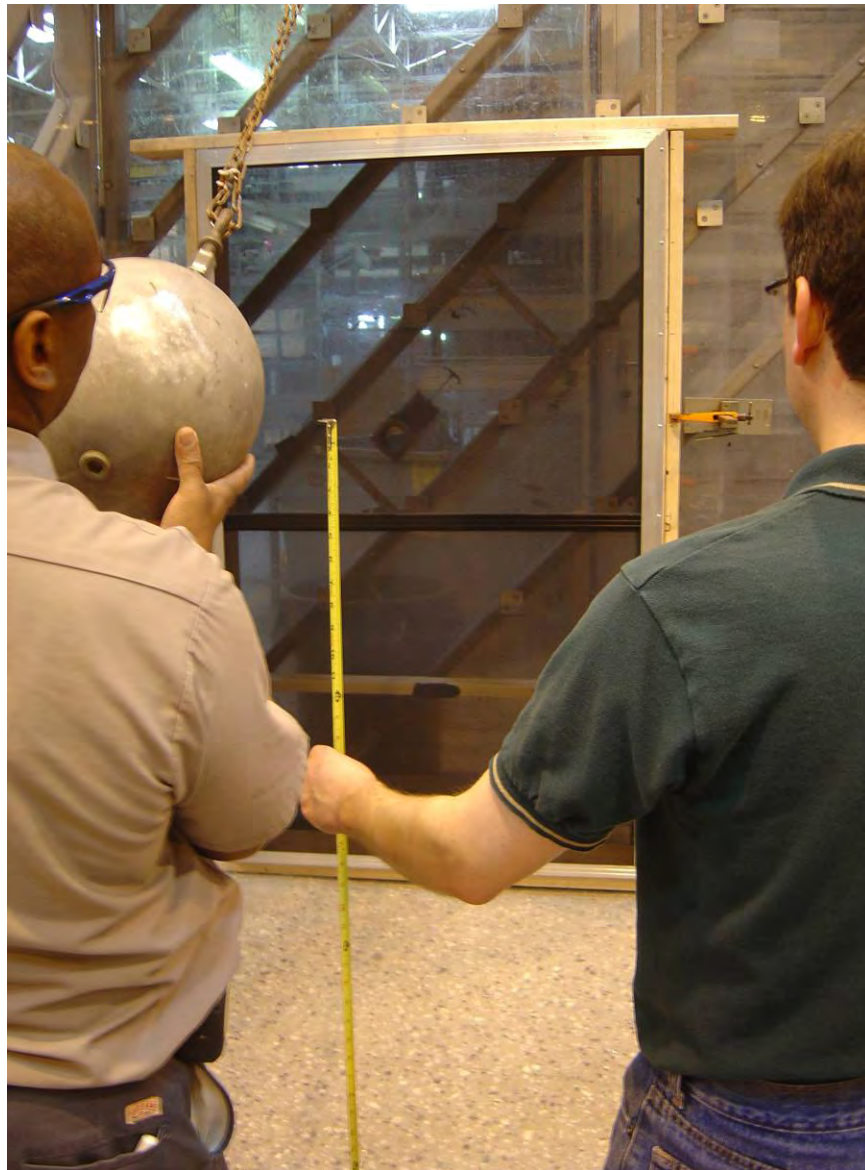


Photo No. 2
Impact Test



Photo No. 3
Test Setup of Sag Test

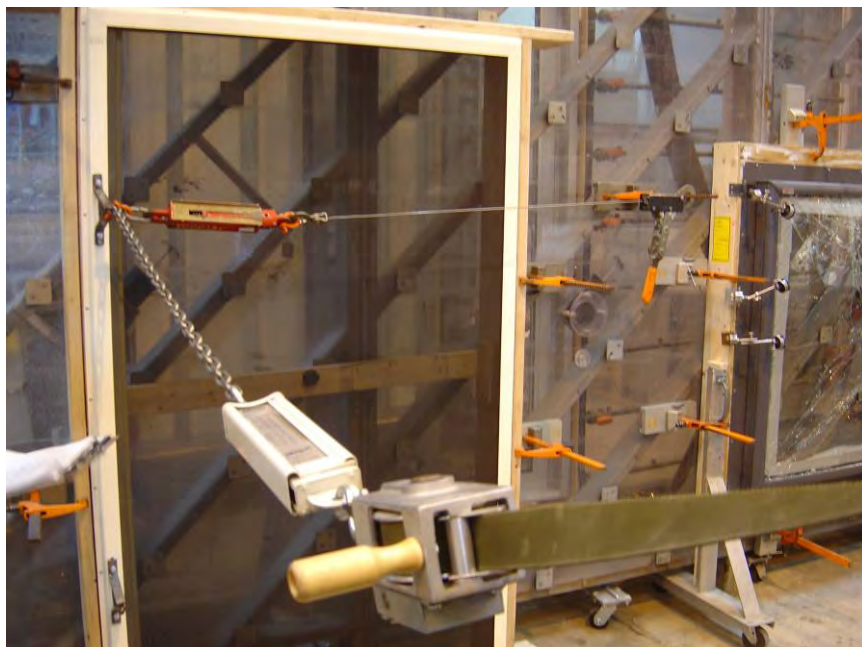


Photo No. 4
Test Setup of Forced Entry Test